


NO.	REVISIONS	APPROVED	DATE

LEGEND:

TC - TOP OF CURB

FL - FLOW LINE

R - RADIUS

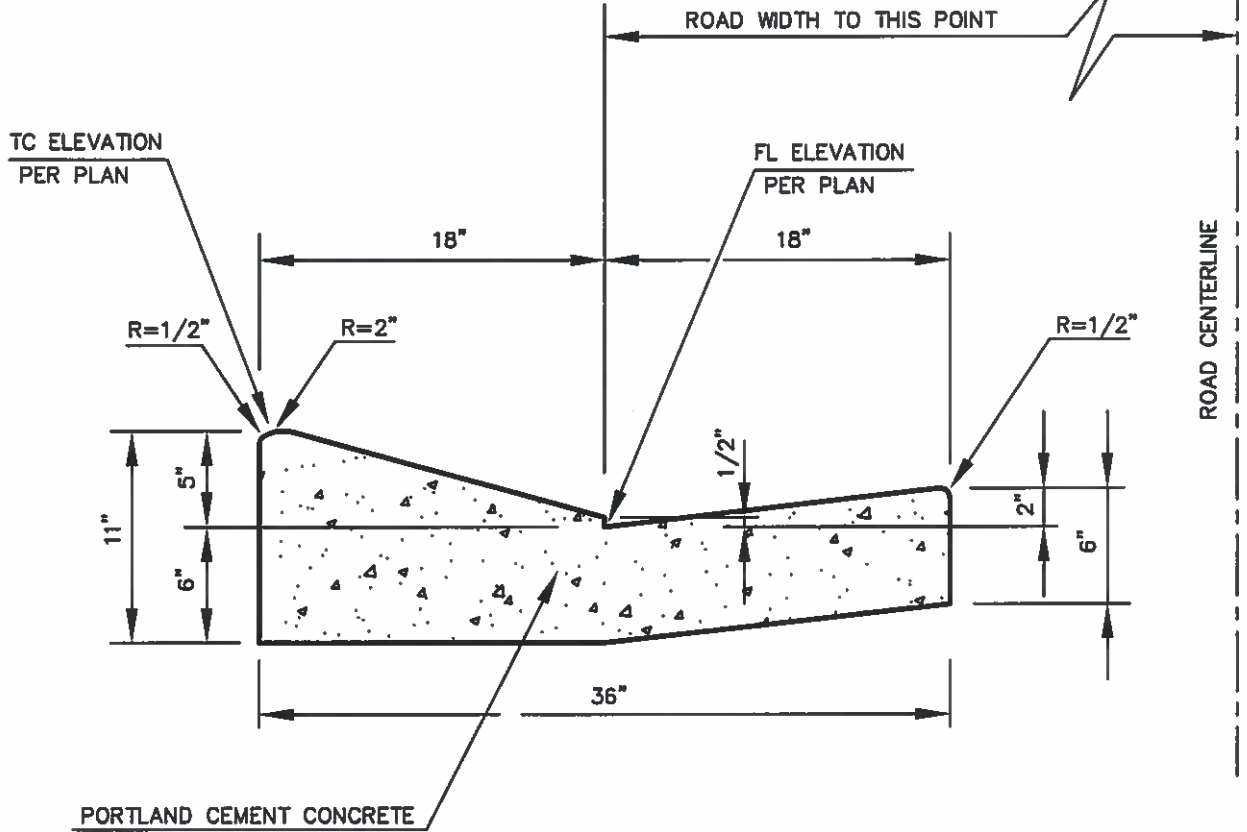

NOTES:

1. MINIMUM PERMISSIBLE GRADE IS 0.50%, UNLESS SPECIFIC APPROVAL IS GIVEN BY THE CITY ENGINEER PRIOR TO DESIGN.
2. THE CURB'S VOLUME IS = 1.844 CF./LF.; 1 CU.YD. = 14.64 LF.
3. SEE C.P.S. STD. DWG. NO. 110 FOR PAVEMENT STRUCTURAL SECTION.
4. PORTLAND CEMENT CONCRETE SHALL BE 560-C-3250 CONCRETE (6 SACK) MIN. IN ACCORDANCE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, LATEST EDITION.
5. EXPANSION JOINTS (1/2" THICK) SHALL BE INSTALLED AT ALL CURB RETURNS.

CITY OF PALM SPRINGS
ENGINEERING SERVICES DEPARTMENT

APPROVED:

[Signature]
CITY ENGINEER

DATE:

4/9/10
48279

R.C.E.

WEDGE CURB

DRAWN BY:

G.F.

FILE NO.

STANDARDS

CHECKED BY:

T.G.

DWG. NO.

202-A