



City of Palm Springs

Department of Building & Safety

3200 East Tahquitz Canyon Way • Palm Springs CA 92262
 Tel 760.323-8242 • Fax 760.322.8342 • www.palmspringsca.gov

OPTIONAL CALCULATION SINGLE-FAMILY DWELLING (NEW OR EXISTING)

1. OTHER LOADS: 220.14

General lighting loads: 220.12
 _____ sq. ft. x 3 VA = _____ VA

Small appliance and laundry loads: 220.52
 1500 VA x _____ circuits = _____ VA

Special loads:

Dishwasher = _____ VA

Disposal = _____ VA

Compactor = _____ VA

Water heater = _____ VA

_____ = _____ VA

_____ = _____ VA

_____ = _____ VA

_____ = _____ VA

(Total) _____ VA

Applying demand factors: 220.82

First 10,000 VA x 100% = 10000 VA

Existing conditions with no

Additional heating or air conditioning loads: 220.83

First 8,000 VA x 100% = 8000 VA

Remaining _____ VA x 40% = _____ VA

(Total) _____ VA

2. HEATING OR A/C LOAD: 220.82

Heating units (3 or less) = _____ VA x 65% = _____ VA

Heating units (4 or more) = _____ VA x 40% = _____ VA

A/C unit = VA x 100% = _____ VA

Heat Pump = VA x 100% = _____ VA

TOTAL = _____ VA

SERVICE: $1 = \frac{VA}{V}$

SERVICE: $1 = \frac{VA}{240} = \text{_____} A$


For a one-family dwelling, the service disconnecting means shall have a rating of not less than 200 amperes, 3-wire, with a minimum 225 amp buss.

Service amperes required _____

Service amperes provided _____

ARC-Fault circuit-interruption protection required per 210.12

Service Section Upgrade-Changeout

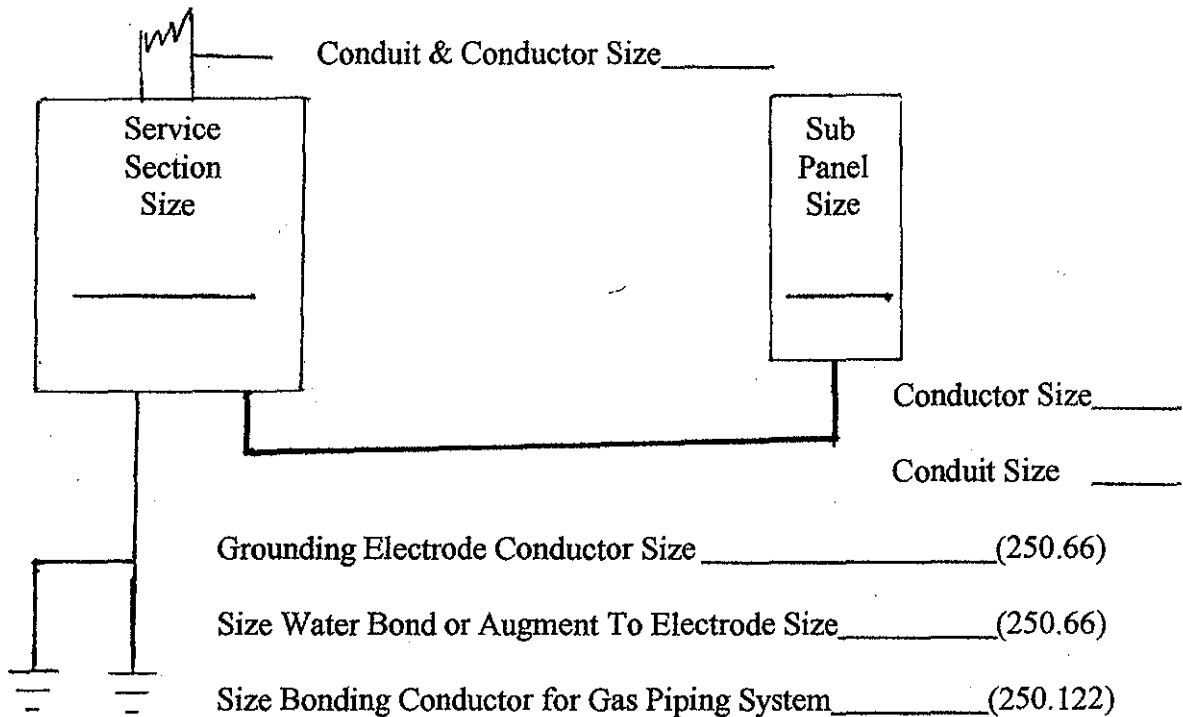

A minimum of two 8' driven ground rods spaced at least 6' apart shall be installed in the absents of a concrete encased electrode (uffer).

Table 250-66 Grounding Electrical Conductor for Alternating-Current Systems

Size of Largest Ungrounded Service-Entrance Conductor or Equivalent Area for Parallel Conductors ^A (AWG/kcmil)		Size of Grounding Electrode Conductor (AWG/kcmil)	
Copper	Aluminum or Copper-Clad Aluminum	Copper	Aluminum ^B
2 or smaller	1/0 or smaller	8	6
1 or 1/0	2/0 or 3/0	6	4
2/0 or 3/0	4/0 or 250	4	2
Over 3/0	Over 250	2	1/0
through 350	through 500	1/0	3/0
Over 350	Over 500	1/0	3/0
through 600	through 900	2/0	4/0
Over 600	Over 900	2/0	4/0
through 1100	Through 1750	3/0	250
Over 1100	Over 1750	3/0	250

Notes:

- Where multiple sets of service-entrance conductors are used as permitted in 230.40, Exception No. 2, the equivalent size of the largest service-entrance conductor shall be determined by the largest sum of the areas of the corresponding conductors of each set.
- Where there are no service-entrance conductors, the grounding electrode conductor size shall be determined by the equivalent size of the largest service-entrance conductor required for the load to be served.

^A This table also applies to the derived conductors of separately derived ac systems.

^B See installation restrictions in 250.64 (A).

Table 250-122 Minimum Size Equipment Grounding Conductors for Grounding Raceway and Equipment

Rating or Setting of Automatic Overcurrent Device in Circuit Ahead of Equipment, Conduit, etc., Not Exceeding (Amperes)	Size (AWG or kcmil)	
	Copper	Aluminum or Copper-Clad Aluminum*
15	14	12
20	12	10
30	10	8
40	10	8
60	10	8
100	8	6
200	6	4
300	4	2
400	3	1
500	2	1/0
600	1	2/0
800	1/0	3/0
1000	2/0	4/0
1200	3/0	250
1600	4/0	350
2000	250	400
2500	350	600
3000	400	600
4000	500	800
5000	700	1200
6000	800	1200

Note: Where necessary to comply with 250.4(A)(5) or 250.4(B)(4), the equipment grounding conductor shall be sized larger than given in this table.

*See installation restrictions in 250.120.

Table 310-15(b)(6). Conductor Types and Sizes for 120/240-Volt, 3-Wire, Single-Phase Dwelling Services and Feeders. Conductor Types RH, RHH, RHW, RHW-2, THHN, THHW, THW, THW-2, THWN, THWN-2, XHHW, XHHW-2, SE, USE, USE-2

Conductor (AWG or kcmil)		
Copper	Aluminum or Copper-Clad Aluminum	Service or Feeder Rating (Amperes)
4	2	100
3	1	110
2	1/0	125
1	2/0	150
1/0	3/0	175
2/0	4/0	200
3/0	250	225
4/0	300	250
250	350	300
350	500	350
400	600	400

Table 310-16. Allowable Ampacities of Insulated Conductors Rated 0 through 2000 Volts, 60°C through 90°C (140°F through 194°F) Not More than Three Current-Carrying Conductors in Raceway, Cable, or Earth (Directly Buried), Based on Ambient Temperature of 30°C (86°F)

Size AWG or kcmil	Temperature Rating of Conductor (See Table 310-13)						Size AWG or kcmil
	60°C (140°F)	75°C (167°F)	90°C (194°F)	60°C (140°F)	75°C (167°F)	90°C (194°F)	
	Types TW, UF	Types FEPW, RH, RHW, THHW, THW, THWN, XHHW, USE, ZW	Types TBS, SA, SIS, FEP, FEPB, MI, RHH, RHW- 2, THHN, THHW, THW-2, THWN- 2, USE-2, XHH, XHHW, XHHW- 2, ZW-2	Types TW, UF	Types RH, RHW, THHW, THW, THWN, XHHW, USE	Types TBS, SA, SIS, THHN, THHW, THW-2, THWN-2, RHH, RHW-2, USE-2, XHH, XHHW, XHHW-2, ZW-2	
COPPER			ALUMINUM OR COPPER-CLAD ALUMINUM				
18	—	—	14	—	—	—	—
16	—	—	18	—	—	—	—
14*	20	20	25	—	—	—	—
12*	25	25	30	20	20	25	12*
10*	30	35	40	25	30	35	10*
8	40	50	55	30	40	45	8
6	55	65	75	40	50	60	6
4	70	85	95	55	65	75	4
3	85	100	110	65	75	85	3
2	95	115	130	75	90	100	2
1	110	130	150	85	100	115	1
1/0	125	150	170	100	120	135	1/0
2/0	145	175	195	115	135	150	2/0
3/0	165	200	225	130	155	175	3/0
4/0	195	230	260	150	180	205	4/0
250	215	255	290	170	205	230	250
300	240	285	320	190	230	255	300
350	260	310	350	210	250	280	350
400	280	335	380	225	270	305	400
500	320	380	430	260	310	350	500
600	355	420	475	285	340	385	600
700	385	460	520	310	375	420	700
750	400	475	535	320	385	435	750
800	410	490	555	330	395	450	800
900	435	520	585	355	425	480	900
1000	455	545	615	375	445	500	1000
1250	495	590	665	405	485	545	1250
1500	520	625	705	435	520	585	1500
1750	545	650	735	455	545	615	1750
2000	560	665	750	470	560	630	2000