


NO.	REVISIONS	APPROVED	DATE

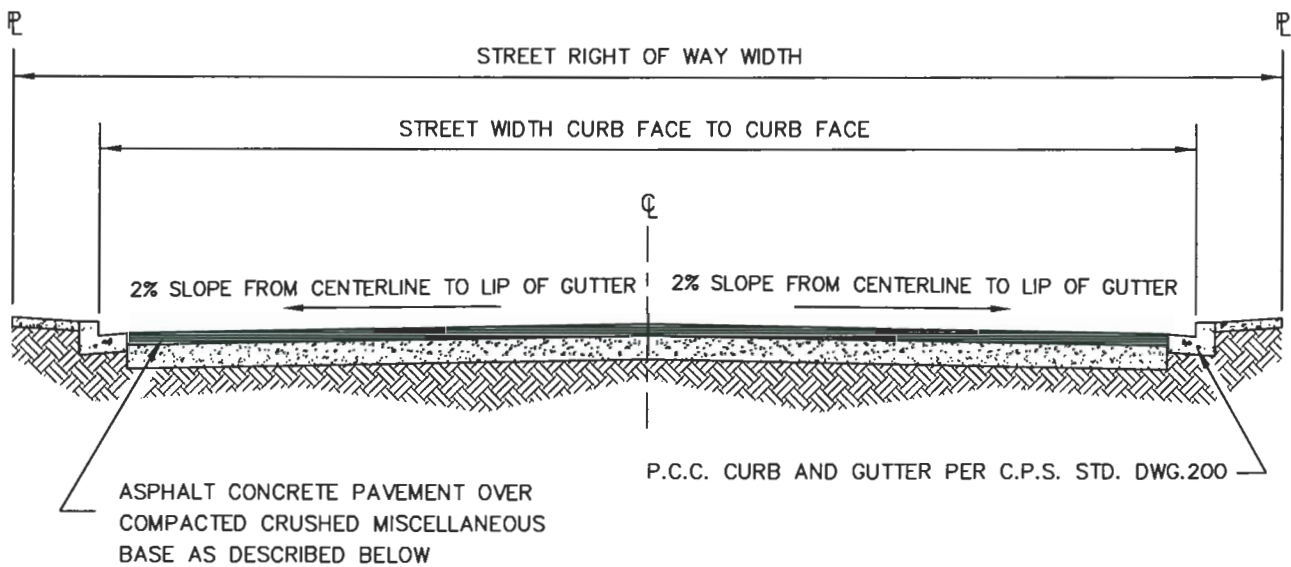

MINOR STREETS:

2-1/2 INCHES OF ASPHALT CONCRETE (1 LIFT) OVER 4 INCHES OF CRUSHED MISCELLANEOUS BASE AND A MIN. SUBGRADE OF 24 INCHES AT 95% RELATIVE COMPACTION. ASPHALT CONCRETE PAVEMENT SHALL BE TYPE C2-AR4000 PER STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, LATEST EDITION.

COLLECTOR AND SECONDARY STREETS:

3 INCHES OF ASPHALT CONCRETE (1 LIFT) OVER 6 INCHES OF CRUSHED MISCELLANEOUS BASE AND A MIN. SUBGRADE OF 24 INCHES AT 95% RELATIVE COMPACTION. ASPHALT CONCRETE PAVEMENT SHALL BE TYPE C2-AR4000 PER STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, LATEST EDITION.

MAJOR THOROUGHFARE STREETS:

5 INCHES OF ASPHALT CONCRETE (2 LIFTS) OVER 4 INCHES OF CRUSHED MISCELLANEOUS BASE AND A MIN. SUBGRADE OF 24 INCHES AT 95% RELATIVE COMPACTION. ASPHALT CONCRETE PAVEMENT SHALL BE TYPE B-AR4000 FOR THE FIRST LIFT AND TYPE C2-AR4000 FOR THE FINAL LIFT PER STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, LATEST EDITION.

NOTES:

1. THICKNESSES SHOWN ARE TO BE CONSIDERED A MINIMUM. ALL NEW PAVEMENT SECTIONS SHALL BE VERIFIED BY SOILS ANALYSIS OF THE NATIVE SUBGRADE BY A REGISTERED GEOTECHNICAL ENGINEER.
2. ASPHALT RUBBER HOT MIX (A.R.H.M.) IS AN ACCEPTABLE SUBSTITUTE FOR THE ASPHALT PAVEMENT SPECIFIED, SUBJECT TO VERIFICATION BY THE CITY ENGINEER.
MIN. 2" NEW CONSTRUCTION
MIN. 1-1/2" CAP OVER EXISTING PAVEMENT
3. ASPHALT CONCRETE PAVEMENT SHALL BE INSTALLED PER STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, LATEST EDITION.
4. PAVEMENT SHALL BE LAID WITH A BARBER GREEN PAVING MACHINE OR EQUAL.
5. A.C. PAVEMENT SHALL BE 1/4 INCH ABOVE LIP OF GUTTER.
6. ASPHALT BINDER USED IN THE ASPHALT CONCRETE PAVEMENT SHALL COMPLY WITH SPECIFICATIONS FOR PERFORMANCE GRADED (PG) 70-10 ASPHALT BINDER, IN ACCORDANCE WITH SECTION 92 "ASPHALTS" OF THE CALTRANS STANDARD SPECIFICATIONS.

CITY OF PALM SPRINGS PUBLIC WORKS & ENGINEERING DEPARTMENT	APPROVED: <i>[Signature]</i>	DATE: <i>[Signature]</i>
	CITY ENGINEER	28931 R.C.E.
STREET PAVEMENT REQUIREMENTS	DRAWN BY: G.F.F.	FILE NO. STANDARDS
	CHECKED BY: M.L.F.	DWG. NO. 110